


SMOKE DETECTOR PLAN

- NOTES:**
1. FOR GENERAL NOTES, LEGEND, RISERS, SEE DRAWING F-1-2-1.
 2. ALL ADDRESSABLE SMOKE DETECTORS CIRCUITS SHALL BE RUN TO EXISTING ATO CABINET.
 3. THE CONTRACTOR SHALL DISCONNECT AND REMOVE THE OLD (EXISTING) SMOKE DETECTORS SHOWN TO BE REMOVED ONLY AFTER THE INSTALLED DEVICES ARE OPERATIONAL AS DIRECTED AND IN THE PRESENCE OF THE ENGINEER.
 4. REFER TO THE MECHANICAL DRAWING M-1 FOR THE REQUIREMENTS AND THE LOCATIONS OF THE PLENUM SMOKE DETECTORS.
 5. CONTRACTOR SHALL LOCATE ALL SMOKE DETECTORS PER BUILDING CODE.

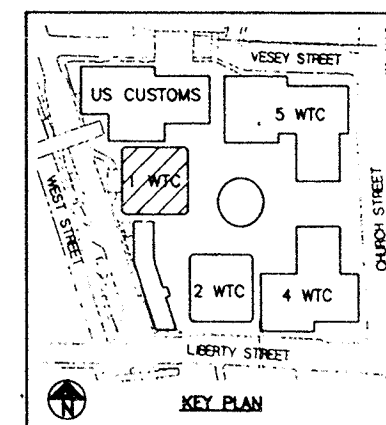

Sheet 01

THE PORT AUTHORITY OF NY & NJ

Joseph R. Loring & Associates, Inc.
consulting engineers

One Pennsylvania Plaza
New York, New York 10119-0045
Tel: (212) 563-7400
Fax: (212) 563-7382

SCR Design Organization, Inc.
architects
305 EAST 46 STREET
NEW YORK, N.Y. 10017
TEL: (212) 421-3500

No.	Date	Revision	Approved
1	8/24/98	AS BID	DC

Engineering Department
Design Division

The World Trade Center

Title
**TOWER 1
FLOOR 78
FIRE ALARM
SMOKE DETECTOR
INSTALLATION AND
REMOVAL PLAN**

This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

F.D.	F.D.	4565.000
Designed by	Drawn by	JRLA JOB No.
4/27/98	P.E.N.	3/32"=1'-0"
Date	Checked by	Scale
Contract Number		Drawing Number
WTC-857.090		F-1-78-2